



PANEL GROUNDING TO LOCAL GROUND
COUNTERPOISE WIRING DETAIL

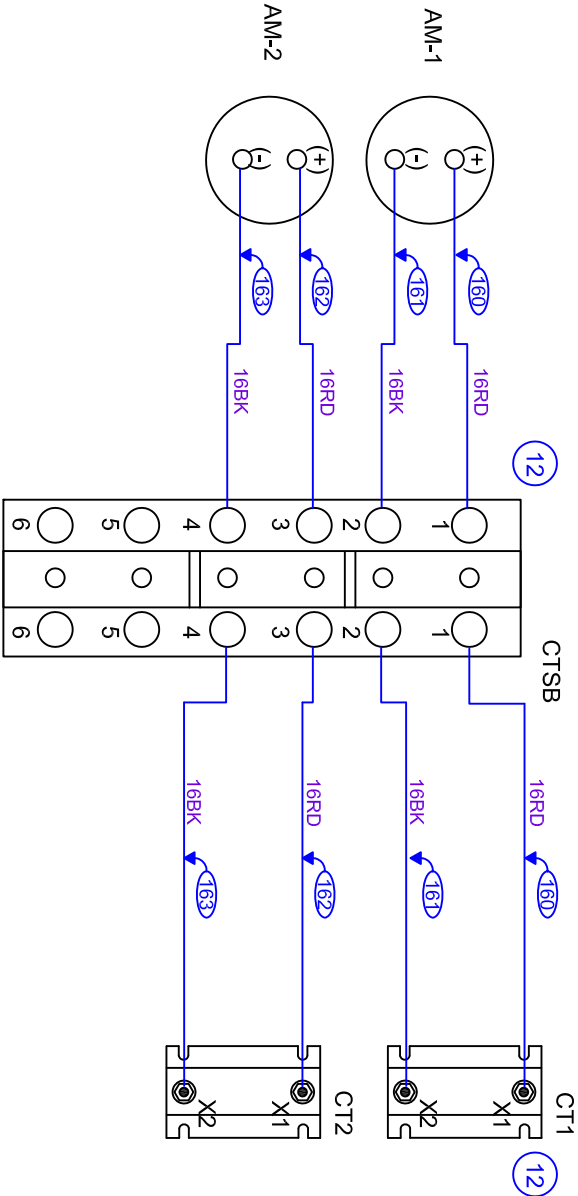

NOTE:
1. "CTSB" WILL BE MOUNTED ON BACK SIDE OF INTERIOR CONTROL PANEL
DOOR

2.COMONENT IDENTIFICATION REFLECTED ON BILL OF MATERIALS
DRAWINGS # 204 AND 205

		SCALE: N.T.S.		-		REVISIONS AS PER MEETING		09-04-2013		JG	
		DESIGN: IAG / LS									
		DRAWN BY: JG									
		APPROVED BY: WW		NO		REVISION		DATE		BY	
<div><p>WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP</p><p>CITY OF ORLANDO, FLORIDA</p></div>											
TITLE: LIFT STATIONS STANDARDS < 25 HP NEMA STARTER DUPELEX PCP ENCLOSURE GROUNDING AND METER WIRING DETAILS											
<div><div>SHEET</div><div>211</div></div>											