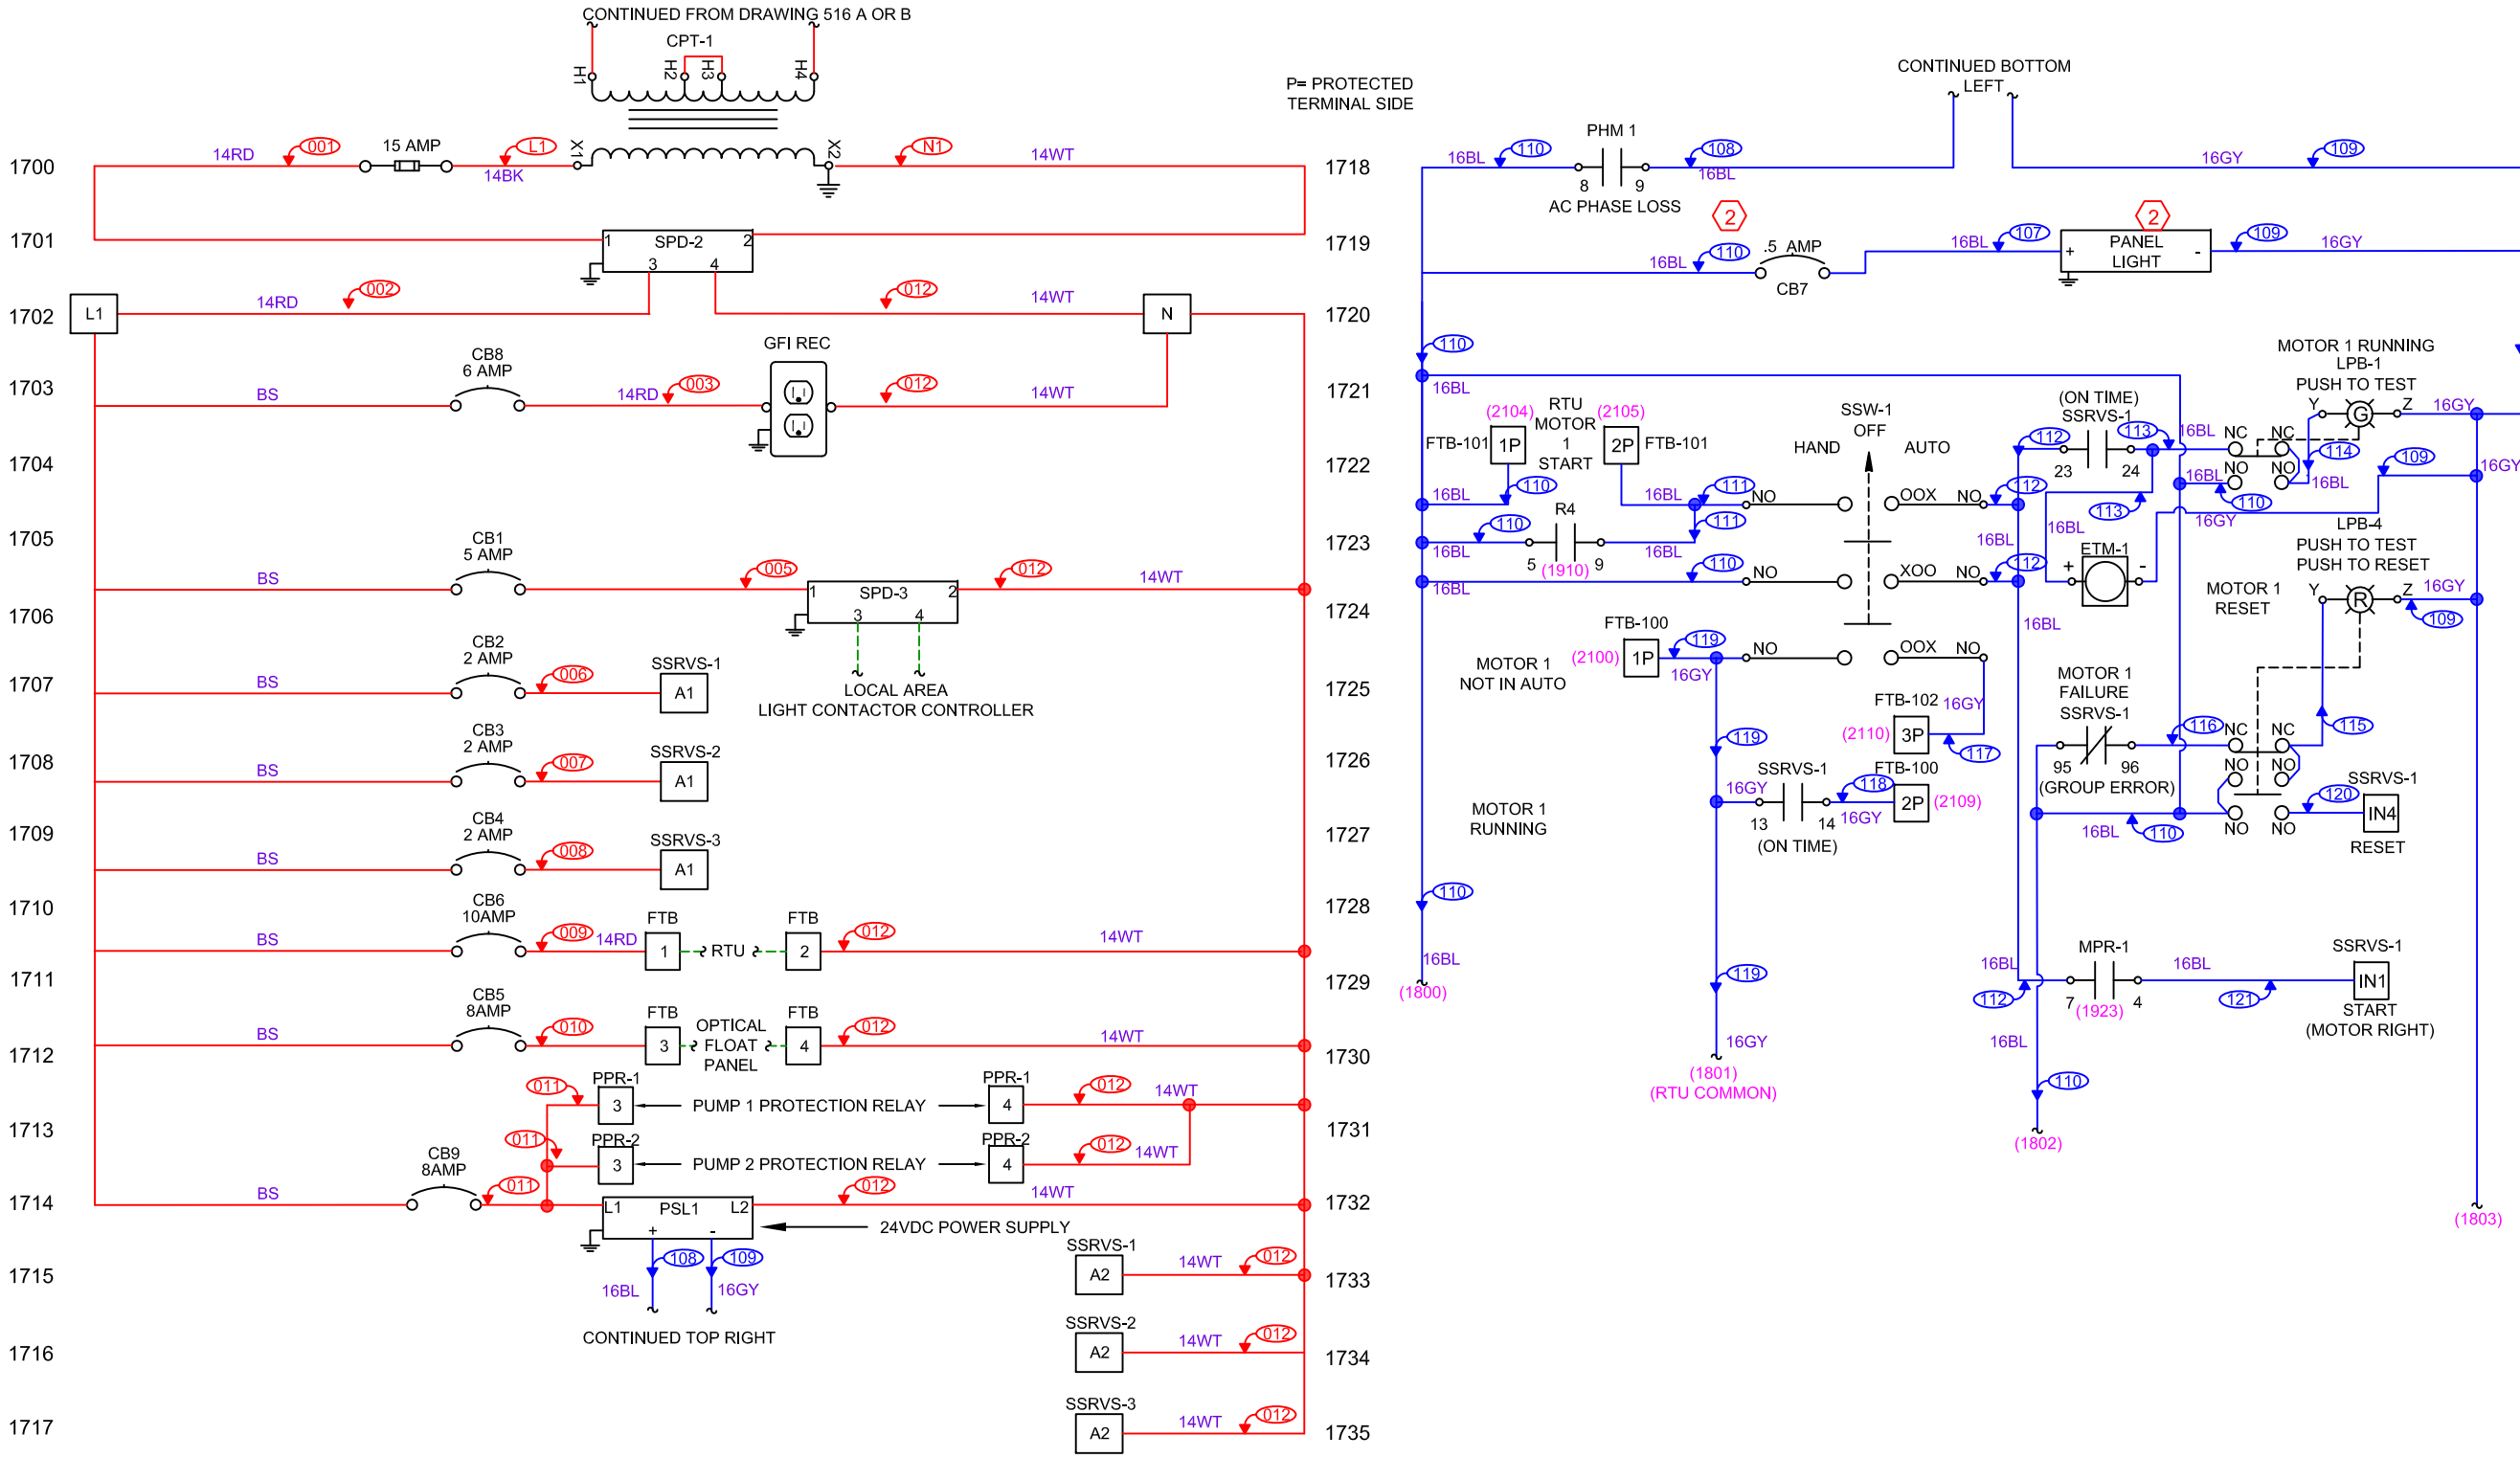

SCALE: N.T.S.		1	ADDED DRAWING LOCATORS	10-25-2013	JG	WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP	TITLE: LIFT STATIONS STANDARDS 25 HP TO < 50 HP TRIPLEX SSRVS PUMP CONTROLLER FOR CONTROL WIRING SCHEMATIC - PART 1
DESIGN: IAG / LS		2	REVISED CABINET LTG WIRING AND CB	11-15-2013	JG		
DRAWN BY: JG		-	REVISED TITLE SHEET DESCRIPTION	06-26-2014	JG	CITY OF ORLANDO, FLORIDA	
APPROVED BY: WW		3	REVISED WIRING TYPOS	06-26-2014	JG		
		4	REVISED TYPOS CIRCUIT BREAKERS	04-10-2015	JG		SHEET 517
		NO	REVISION	DATE	BY		