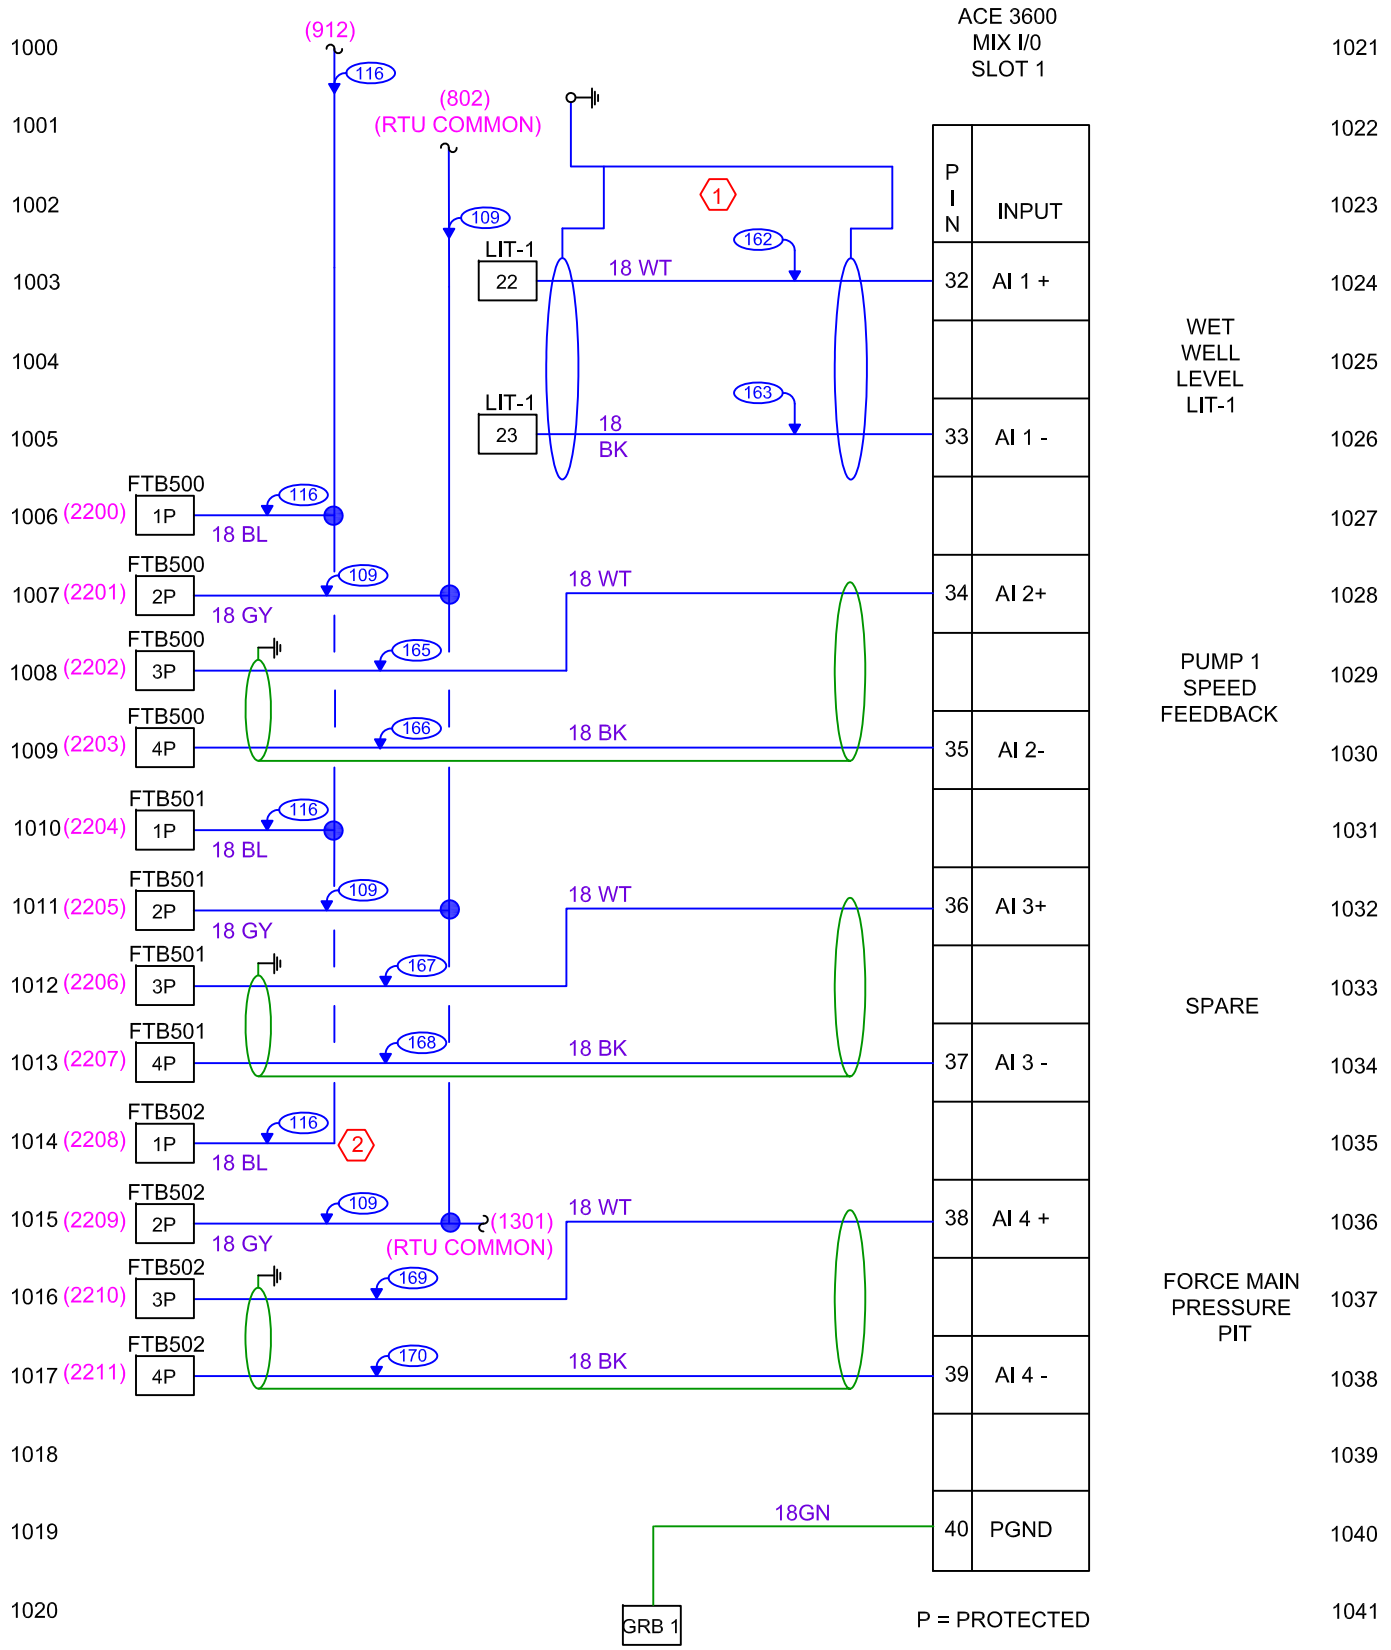

SCALE: N.T.S.	-	ADDED FTB DRAWING NOTES AND LAYER	10-17-2013	JG	WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP
DESIGN: IAG / LS	-	ADDED FTB FOR SSM-1 AND REVISED TO SSW-1	01-28-2015	JG	CITY OF ORLANDO, FLORIDA
DRAWN BY: JG	1	REMOVED FTB FOR SSM-1 AND REVISED TO SSW-1	04-03-2015	JG	TITLE: LIFT STATIONS STANDARDS RTU FOR ≥ 50 HP VFD WITH SSRVS PUMP CONTROL PANEL (PCP) SLOT 1 MODULE WIRING SCHEMATIC PART 3
APPROVED BY: WW	2	REMOVE PUMP DISAGREE WIRING	06-15-2015	JG	SHEET 610
	NO	REVISION	DATE	BY	