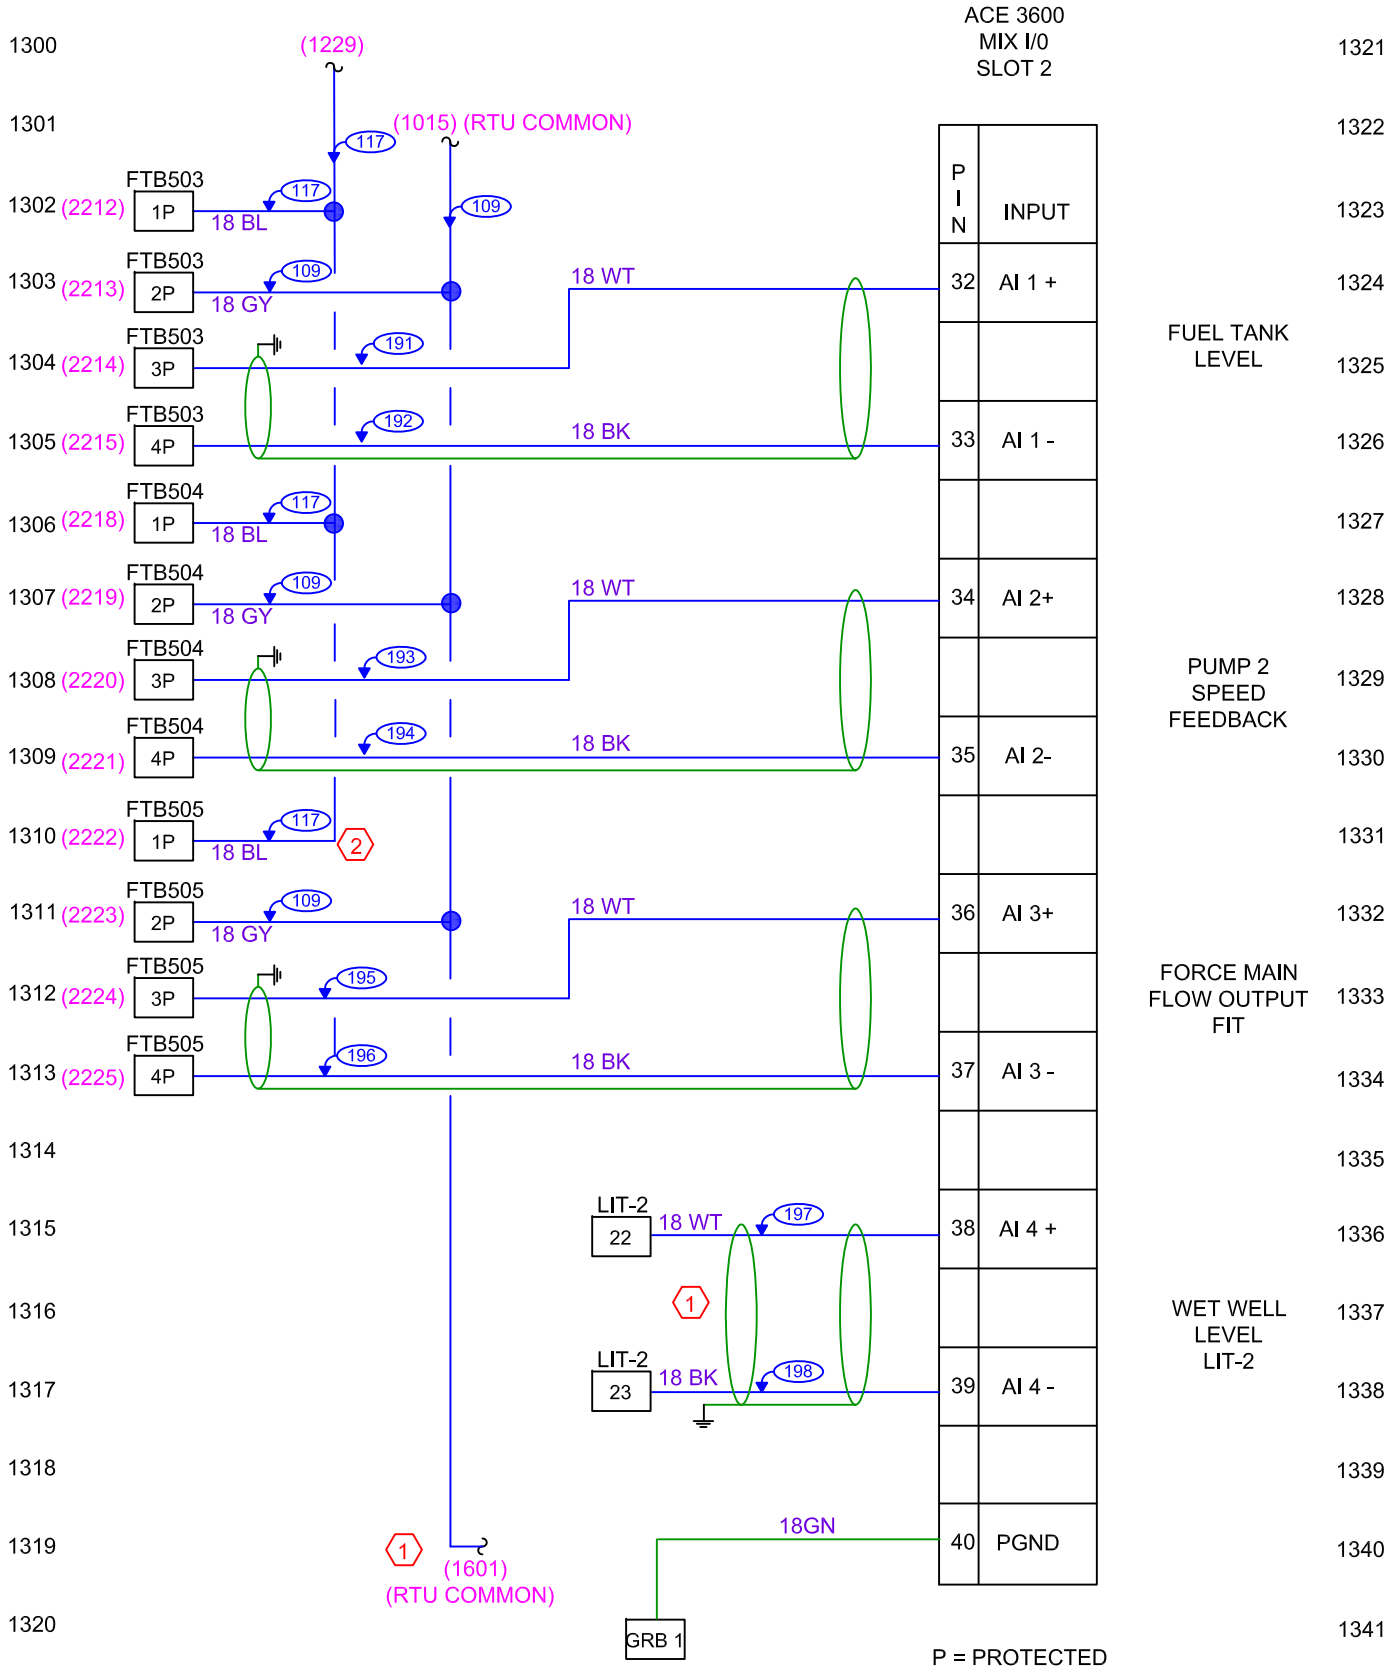

SCALE: N.T.S.	-	ADDED FTB DRAWING NOTES AND LAYER	10-17-2013	JG	WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP CITY OF ORLANDO, FLORIDA
DESIGN: IAG / LS	1	ADDED LIT-2 INPUT	03-14-2015	JG	TITLE: LIFT STATIONS STANDARDS RTU FOR ≥ 50 HP VFD WITH SSRVS PUMP CONTROL PANEL (PCP) SLOT 2 MODULE WIRING SCHEMATIC PART 3
DRAWN BY: JG	2	REMOVED PUMP DISAGREE WIRING	06-15-2015	JG	SHEET 613
APPROVED BY: WW	NO	REVISION	DATE	BY	