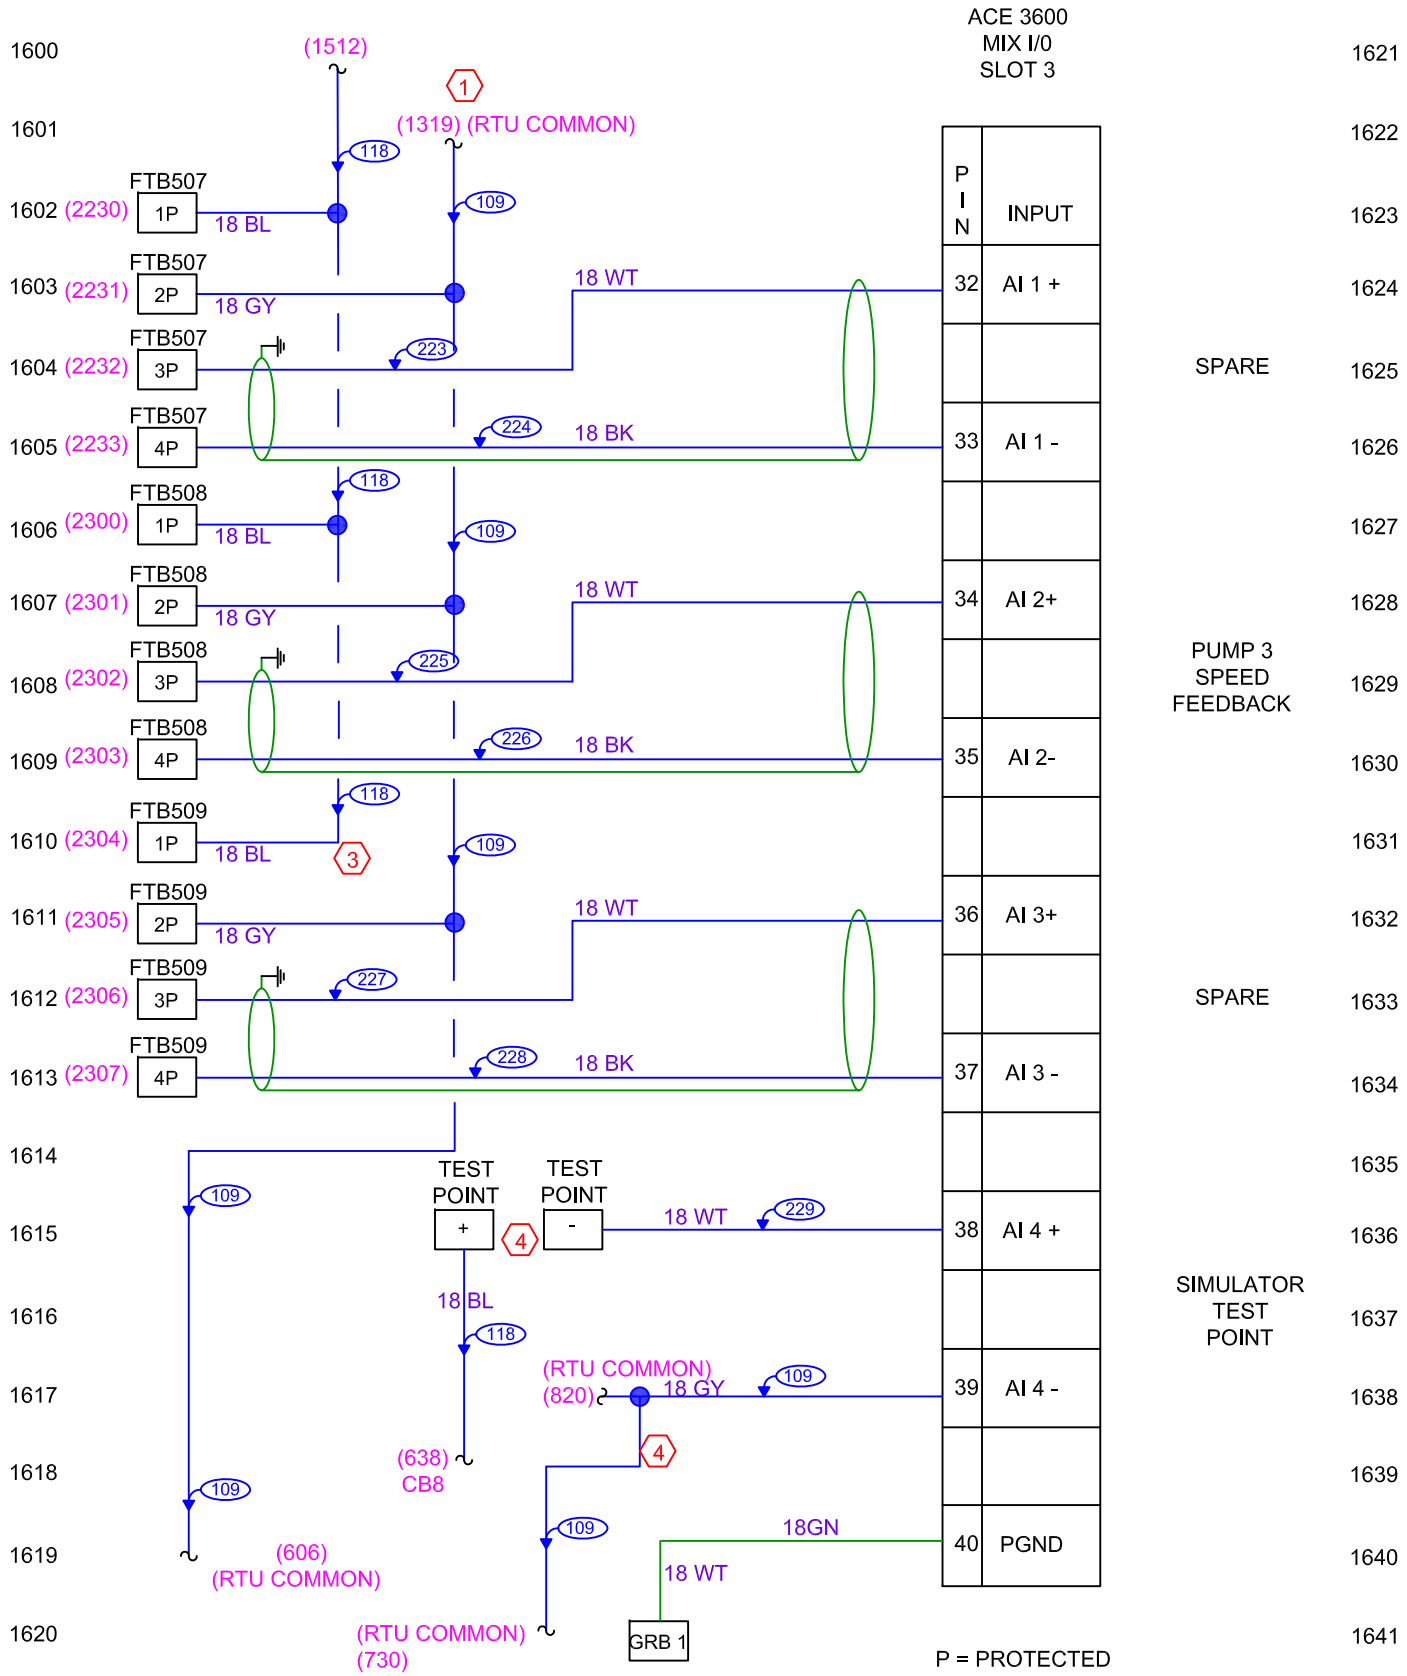

SCALE: N.T.S.	1	ADDED FTB DRAWING NOTES AND LAYER	10-17-2013	JG	WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP CITY OF ORLANDO, FLORIDA
DESIGN: IAG / LS	2	ADDED AI FOR SIMULATOR TEST POINT	03-04-2015	JG	
DRAWN BY: JG	3	REMOVE PUMP DISAGREE WIRING	06-15-2015	JG	
APPROVED BY: WW	4	REVISED WIRNG FOR ANALOG TEST POINT	06-19-2015	JG	
	NO	REVISION	DATE	BY	

TITLE: LIFT STATIONS STANDARDS
RTU FOR ≥ 50 HP VFD WITH SSRVS PUMP CONTROL PANEL (PCP)
SLOT 3 MODULE WIRING SCHEMATIC
PART 3

SHEET
616