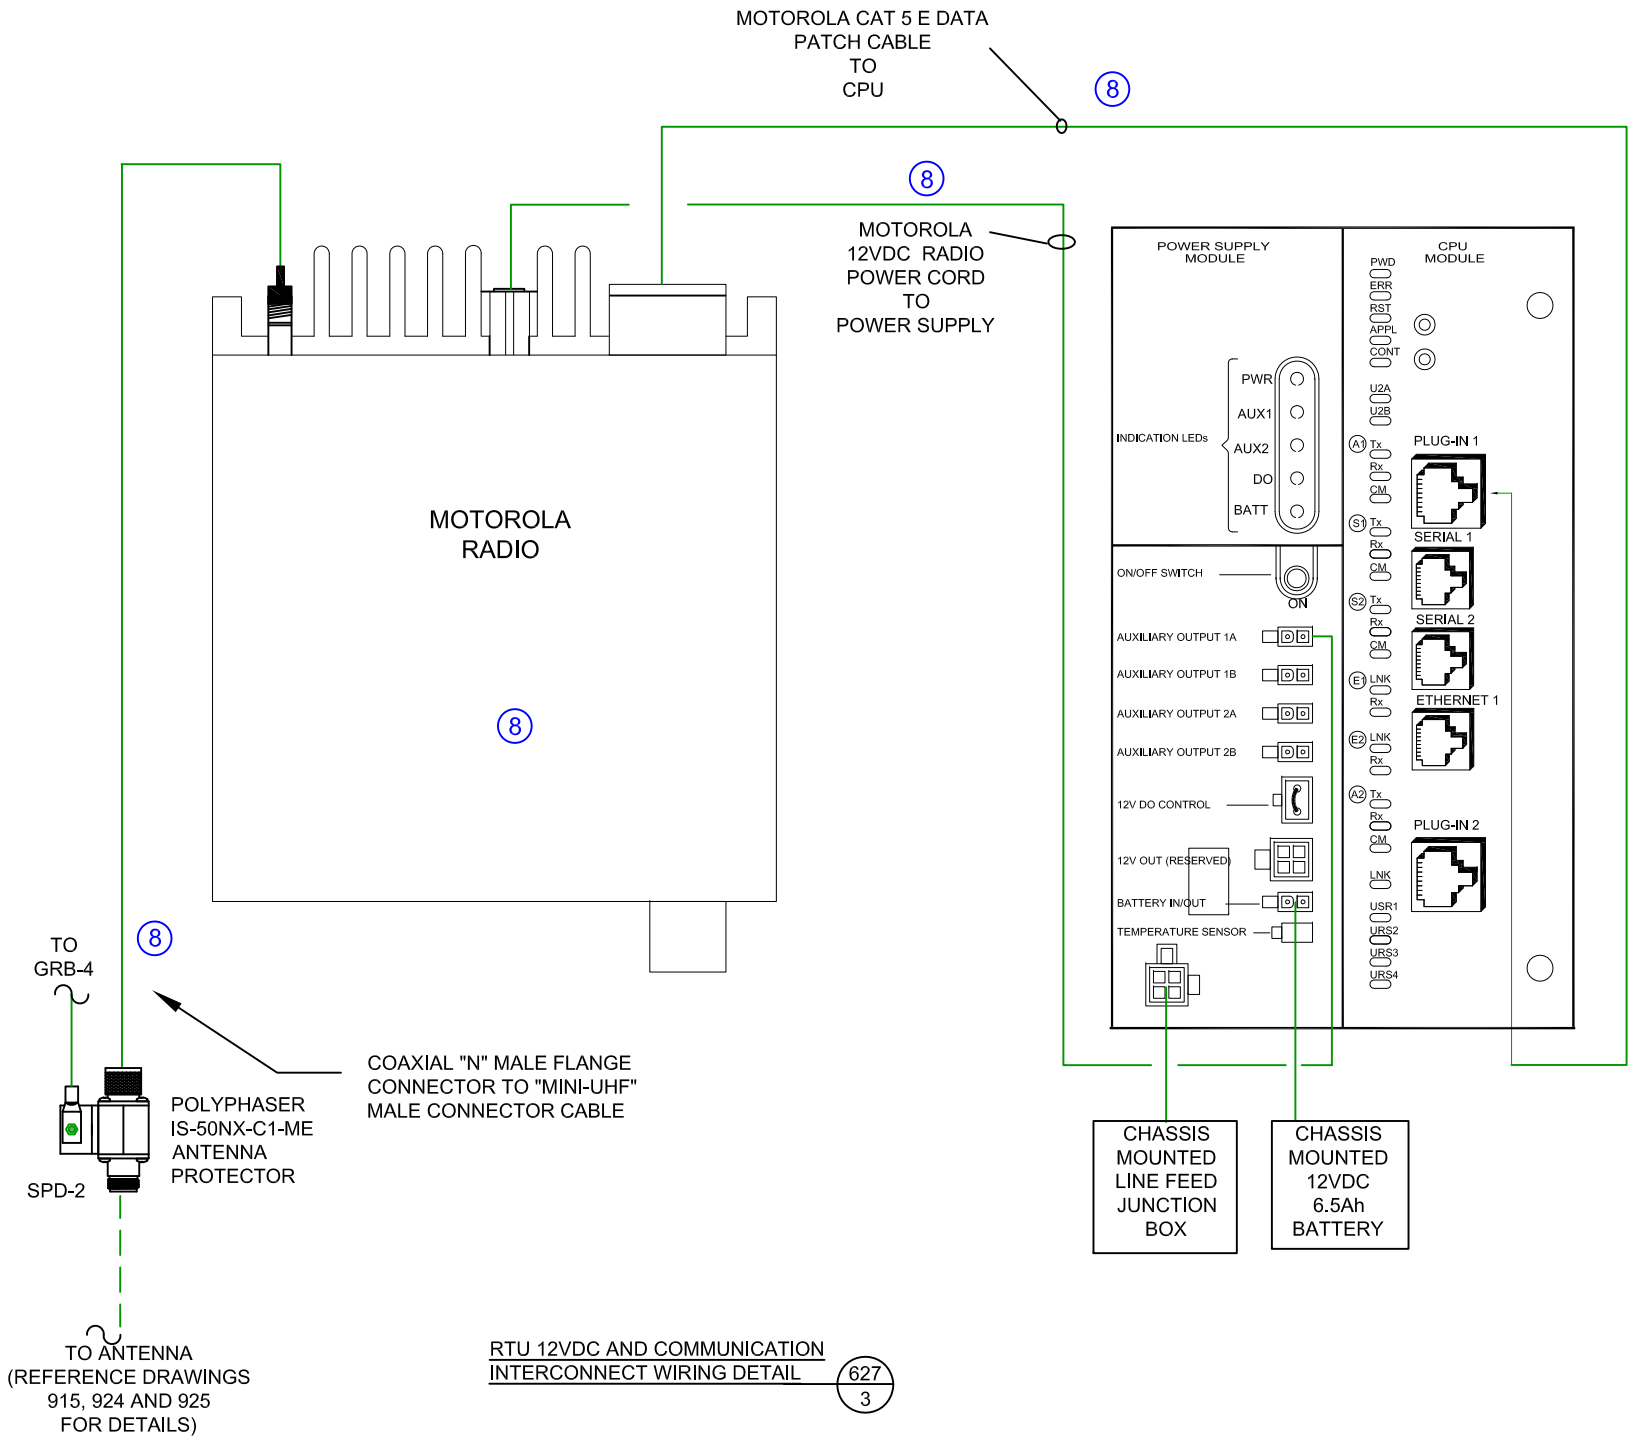

RTU 12VDC AND COMMUNICATION INTERCONNECT WIRING DETAIL 627/3

REMOVED WIRING SCHEMATIC
06-12-2015

SCALE: N.T.S.	-	REVISIONS AS PER MEETING	09-30-2013	JG	WASTEWATER DIVISION, INDUSTRIAL AUTOMATION GROUP CITY OF ORLANDO, FLORIDA
DESIGN: IAG / LS	-	REVISED DETAIL AND SHEET NUMBERS	01-28-2015	JG	TITLE: LIFT STATIONS STANDARDS RTU FOR ≥ 50 HP VFD WITH SSRVS PUMP CONTROL PANEL (PCP) COMM, 12 VDC, PUMP DISAGREE LAYOUT WIRING DETAILS
DRAWN BY: JG	-	REMOVED GROUNDING DETAIL	03-04-2015	JG	SHEET 627
APPROVED BY: GM	-	REMOVED PUMP DISAGREE WIRING SCHEMATIC	06-15-2015	JG	
	NO	REVISION	DATE	BY	